



GENERAL DESCRIPTION:

The HOSE STREAM 120® First Responder is a deployable Steel-Tex fire shutter system composed of a wired reinforced Steel-Tex on a round steel tube in a fire rated assembly. The Steel-Tex fire shutter remains retracted above the finished ceiling until activated by fire alarm or smoke alarm at which point it descends at 6 in/sec. and creates a smoke and fire barrier. The fire shutter can also be non-motorized when activated by a fusible link for smaller openings. The system consists of:

- A roller assembly with a 0.05 in. thick galvanized steel head box with a minimum 12 in. x 12 in. dimension. Maximum span up to 150 ft. and drop height of 46 ft.
- A motor controller (MC) is housed in a steel enclosure and mounted onto the motor end of the head box. NFPA 70 compliant DC motor interfaced with Control Panel (CP) and a suitably weighted bottom bar. Internal motor system.
- Removable fire rated cover plates incorporated to allow access to shutter roller.
- Shutter passes through fire rated galvanized steel aside guides that are factory primed and can be painted in the field by others.
- If required, egress switches can be provided on both sides of shutter when shutter is in the path of egress.
- Tested at Guardian Fire Testing Laboratories. Accreditation
ISO 17025 (testing)
ISO 17020 (inspection)
ISO 17065 (production certification)


STANDARDS:

The HOSE STREAM 120® First Responder

- Tested in accordance to UL 10B and ASTM E2226 (Hose Stream Test) for 90 minutes. Certified by Guardian.
- NFPA 252 Compliance. Certified by Guardian
- UL864 Releasing Device USA & Canada 110V or 220V - Certified by Intertek

PERFORMANCE:

- Hose Stream 120® First Responder is utilized for openings for up to a 2 hour fire wall or fire barrier per IBC 715.3
- First Responder Door for Ingress and Egress per NFPA 101
- There is no fastener, no magnet, no latch at the door opening as the weight of the fabric keeps the door closed
- Door Opens 6 foot 8 inches, threshold 19 mm, which is beveled with a Slope not greater than 50%
- Opening Force less than five pounds
- There is a side hinge at the bottom bar that allows for swinging of the fabric that creates the back force to swing
- Building Management System Relay per UL 864
- Beam Obstruction Sensor Option
- Leading Edge Safety Sensor option
- Fail Safe battery backup Standard
- Up Buttons on Wall or Side Guide option
- Membrane Switch directly on Steel- Tex option
- Delayed Descent or Two stage Descent Option
- Confirmation of bottom bar full descent to floor option

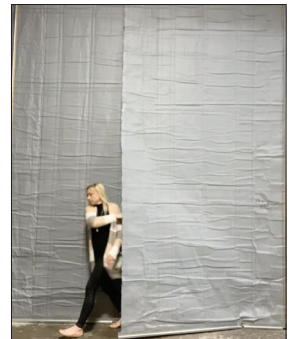


Hose-Stream Application Does Not Open First Responder Door

**After Hose-Stream Test


No Fastener at Fabric Overlap Push to Exit

HEADBOX INSTALLATION OPTIONS


There are many installation options that suit all types of ceiling configurations and provide a broad array of flexibility.




Unistrut Installation



I Beam




Back Mounted



Top Mounted


FINISHED CEILING OPTIONS



Shadow Gap

SIDE GUIDE CONFIGURATION

The side guide is recessed flush as shown below:




Flush

CONTROL PANEL (CP):

The Steel-tex fire shutter deployment mechanism is directly synced and integrated in the fire alarm emergency systems.

When an alarm signal is detected, the Control Panel (CP) will automatically trigger the shutter systems to deploy in a controlled descent under gravity. In normal operating conditions the CP provides AC supply to the Motor Controller (MC) to keep the shutters in retracted condition. Should smoke be detected, the fire alarm control system will send a signal to the CP and the shutters will deploy at a controlled speed to their operational position. When the fire alarm system goes back to normal power mode, the shutters will automatically retract back to the housing.

STEEL-TEX FIRE SHUTTER DIAGRAM

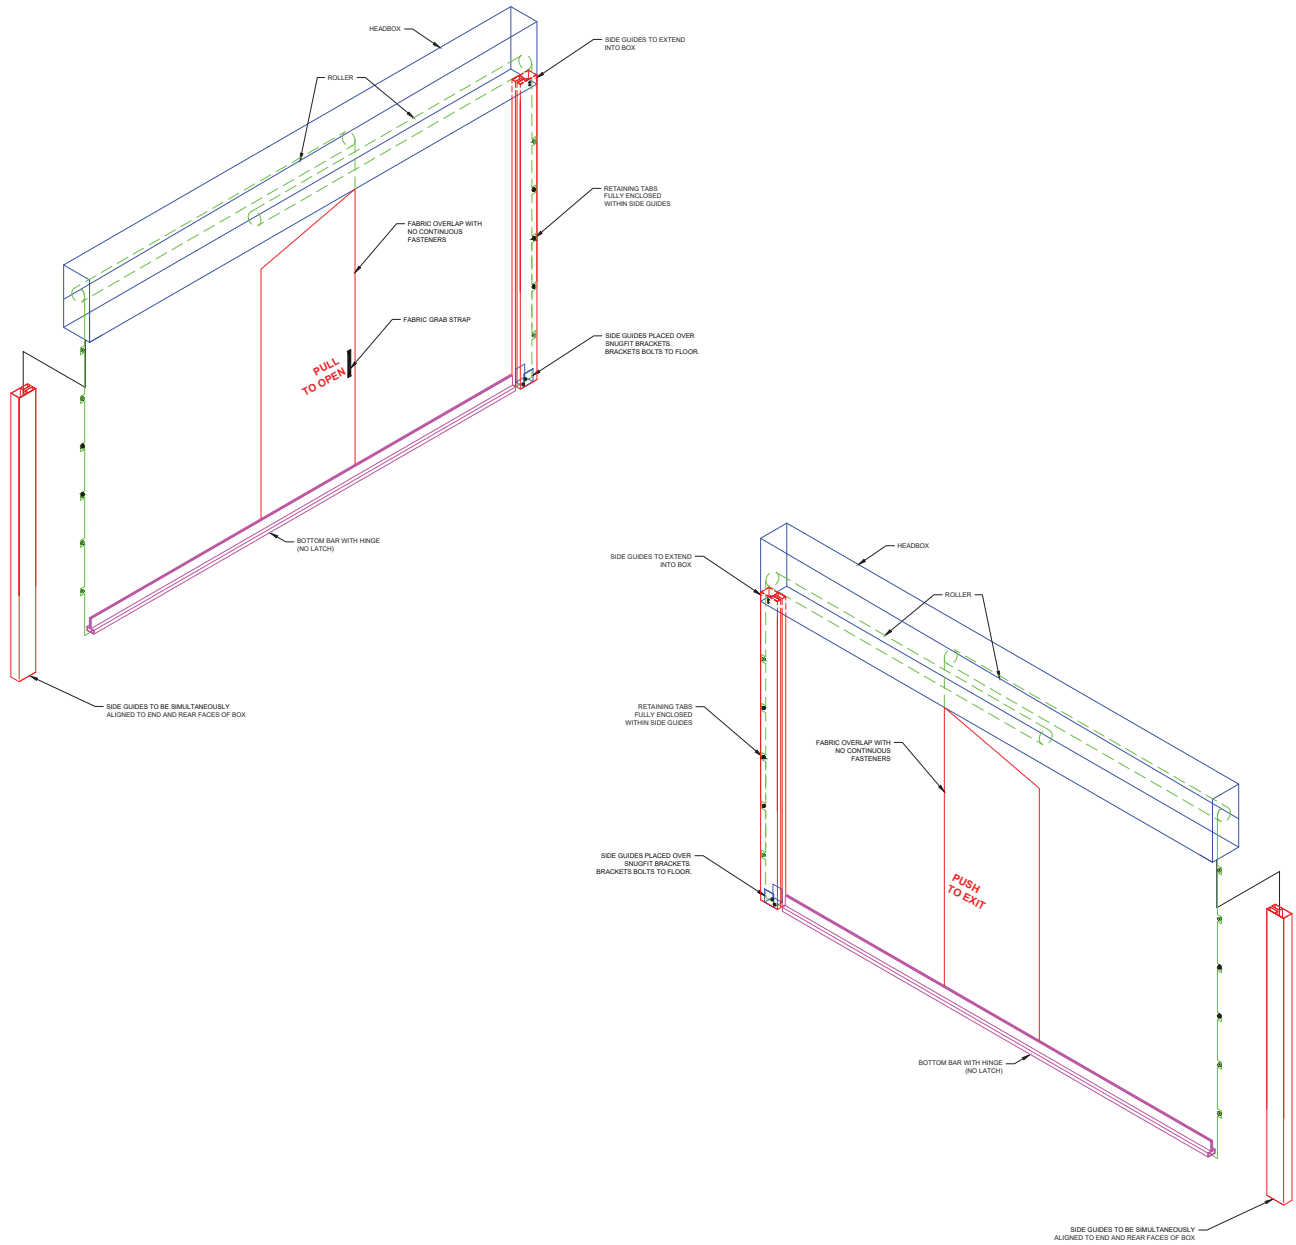

U.S. SMOKE & FIRE®

12310 Pinecrest Road, Suite 300, Reston, VA 20191 • Phone: 888.917.8777 • Fax: 888.917.8777
 Washington, DC • Boston • New York • Miami • Dallas • San Francisco
www.us smokeandfire.com • aeteam@us smokeandfire.com

